



Certificate of Completion

Duct Sealing Performed For:

Sun City, AZ 85351

Overall Sealing Results

When we arrived,
YOUR DUCTS HAD:

74.9 CFM of Leakage, equivalent to a
14.2 Square Inch Hole


This equals 44.9 refrigerators full of air loss every hour.

After we finished,
YOUR DUCTS HAVE:

9.1 CFM of Leakage, equivalent to a
1.7 Square Inch Hole

This corresponds to a **87.9% Reduction** in
Duct Leakage.

Note: Duct Leakage results are calculated in Cubic Feet per Minute (CFM) measured at a standard OPERATING PRESSURE of 25 Pa.

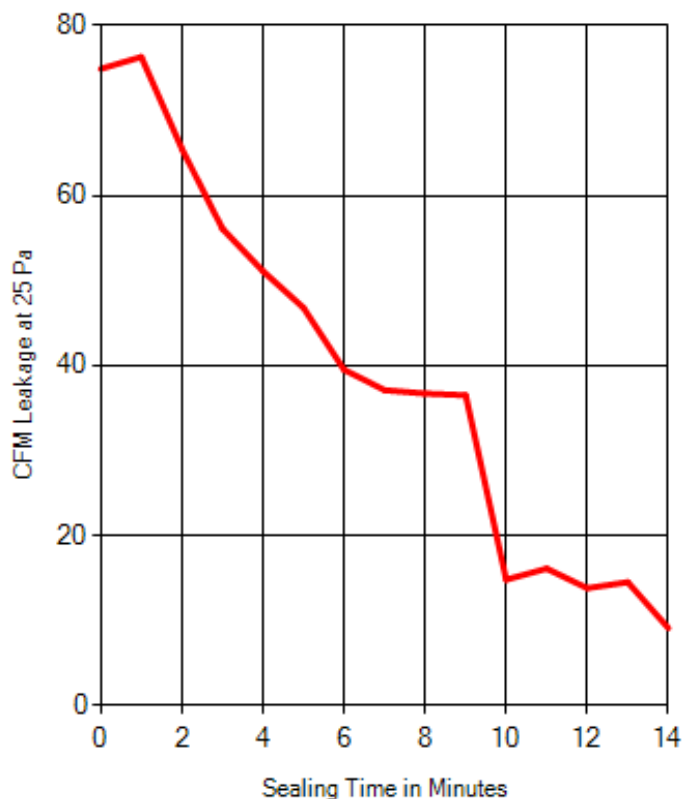

Aeroseal Technician **Ty**

Aeroseal Case ID **4474**

Date of Seal **8/20/2018**

System Description **Single Seal**

Seal Description **Seal**

Hardware **HomeSeal**

AEROSEAL[®]
Duct Sealing From The Inside